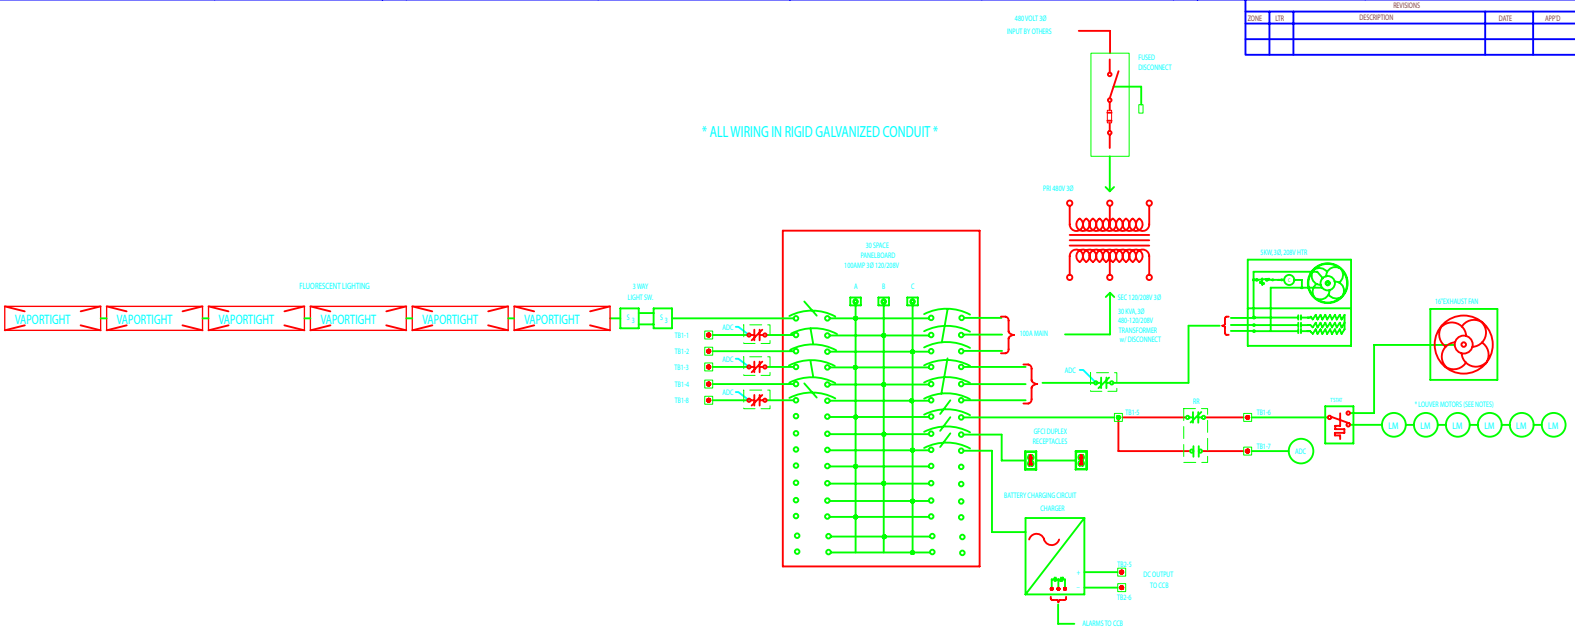

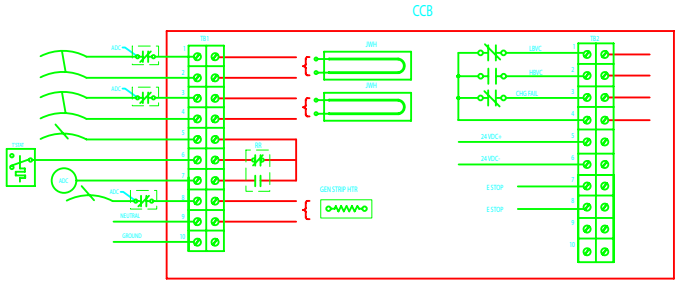

E-STOP CONTACTS WILL BE
NORMALLY CLOSED, HELD OPEN

LEGEND:

- CCB - CUSTOMER CONNECTION BOX
- LBVC - LOW BATTERY VOLTAGE CONTACTS
- HBVC - HIGH BATTERY VOLTAGE CONTACTS
- CHG FAIL - BATTERY CHARGER FAIL ALARM CONTACTS
- ADC - AUX DISCONNECT
- RR - RUN RELAY
- AC - ALTERNATE CURRENT
- DC - DIRECT CURRENT
- WIRING BY OTHERS
- WIRING BY PB, TERMINATED BY OTHERS

* NOTES:

- LOUVERS ARE SPRING OPEN / MOTOR CLOSE
- RUN RELAY LOCATED IN ENGINE CONTROL PANEL UNLESS OTHERWISE NOTED
- FUSE LOCATED IN DC PB SUPPLIED JUNCTION BOX

REVISIONS				
ZONE	LTR	DESCRIPTION	DATE	APP'D

CUSTOMER: OHIO ENGINE POWER

REFERENCE: IBM/QWEST CYBER CENTERS - YONKERS

UNITS REQ'D: (2) TWO

THIRD ANGLE PROJECTION

REVISION

PATENT NO. 5,862,642
NOTICE TO PERSONS RECEIVING THIS DRAWING:
PRITCHARD-BROWN DIV. of ENVIRO-INDUSTRIES, INC CLAIMS
PROPRIETARY RIGHT IN THE MATERIAL DISCLOSED HEREON. THIS
DRAWING IS ISSUED FOR SALES INFORMATION ONLY AND MAY
NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN
HEREON WITHOUT PERMISSION FROM PRITCHARD-BROWN DIV. OF

PRITCHARD-BROWN
DIV. of ENVIRO-INDUSTRIES, INC.
6501 ERDMAN AVE.
BALTIMORE, MD. 21205

DATE: 03 / 16 / 01

ELECTRICAL ONE LINE

DRW.	CF	JOB SERIAL NO.	M011048/49
CHK.	RG		
APP.	RG		
APP.	RVB	SCALE: N.T.S.	SHEET 3 OF 3

Created w/ AutoCAD